


CAPACIDADE OCIOSA

MMm³

Janeiro/2014

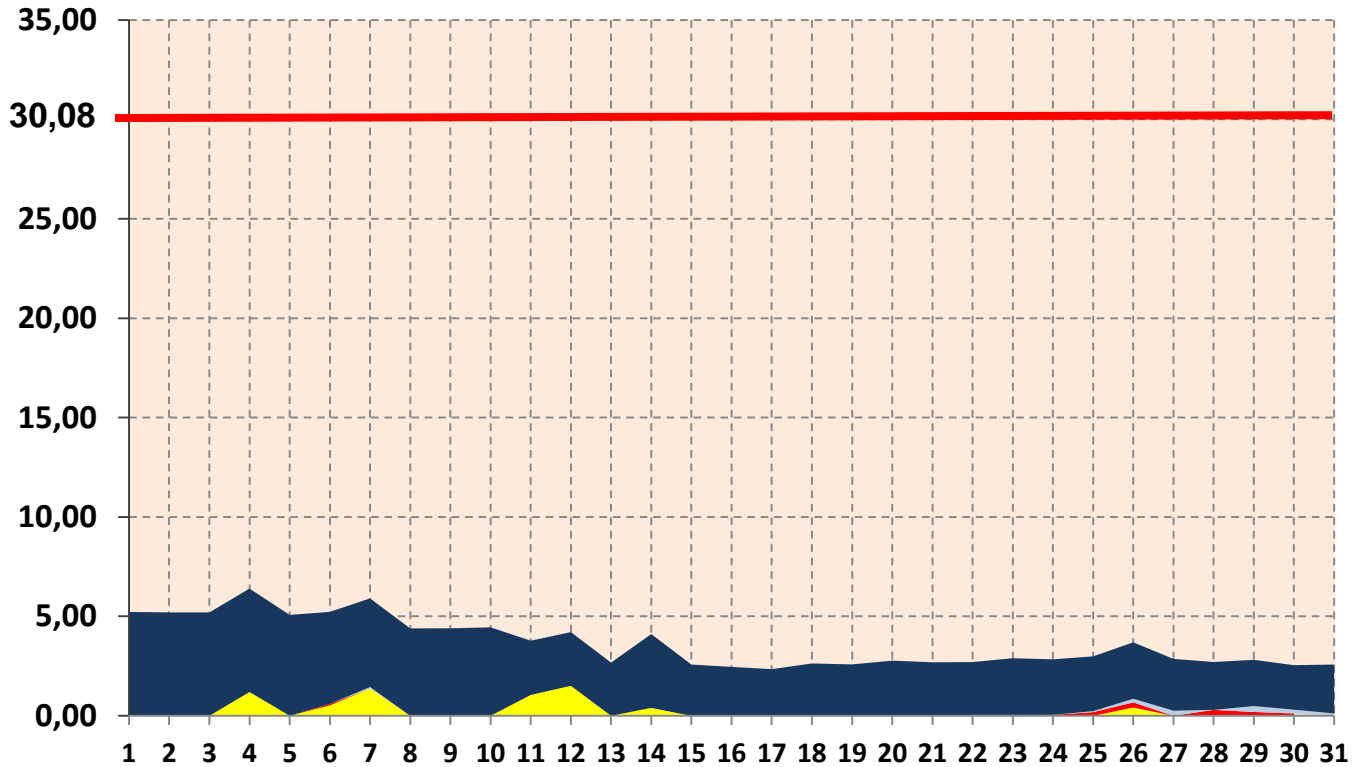

CPAC

3,35 MM m³/dia

TCX

0,04 MM m³/dia

TCO

0,04 MM m³/dia

TCQ

0,21 MM m³/dia