




CAPACIDADE OCIOSA

MMm³ Dezembro/2015

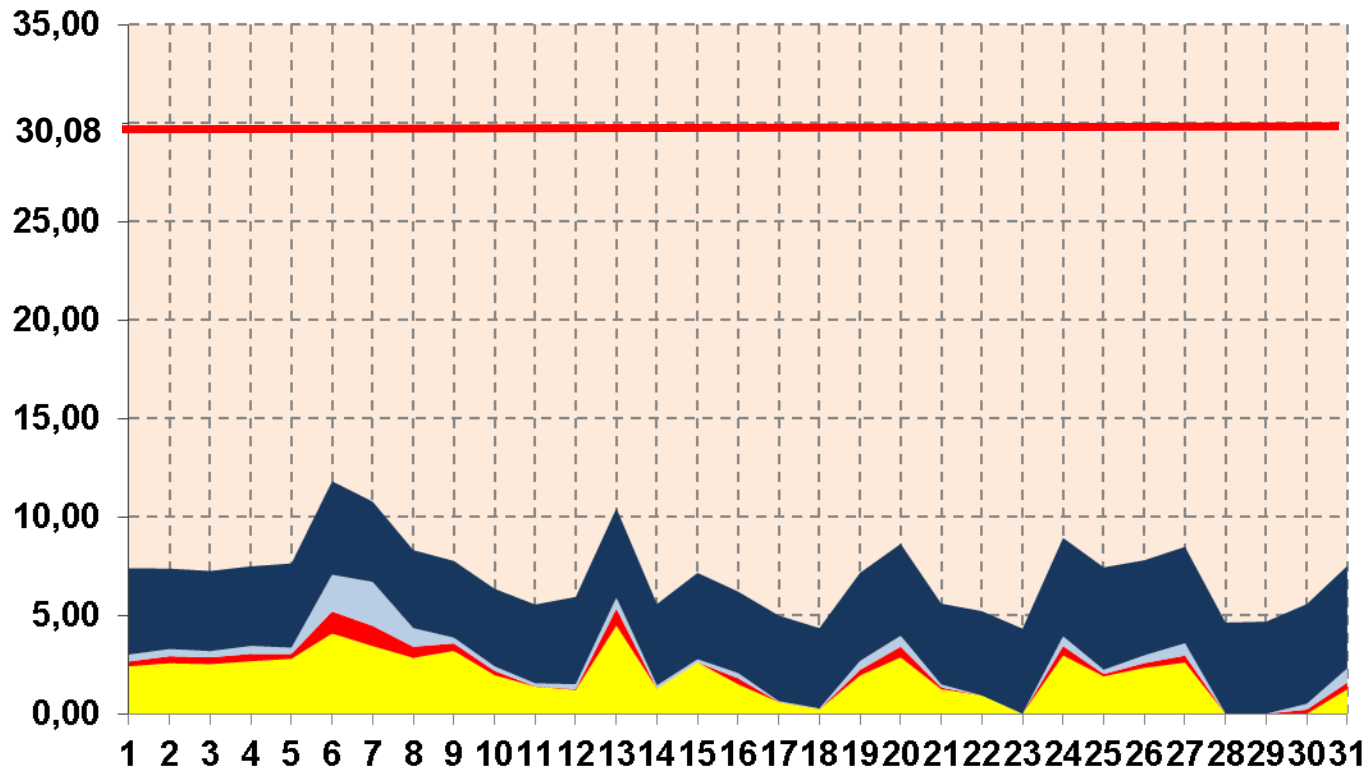

CPAC

4,41 MMm³/dia

TCX

0,42 MMm³/dia

TCO

0,28 MMm³/dia

TCQ

1,93 MMm³/dia